


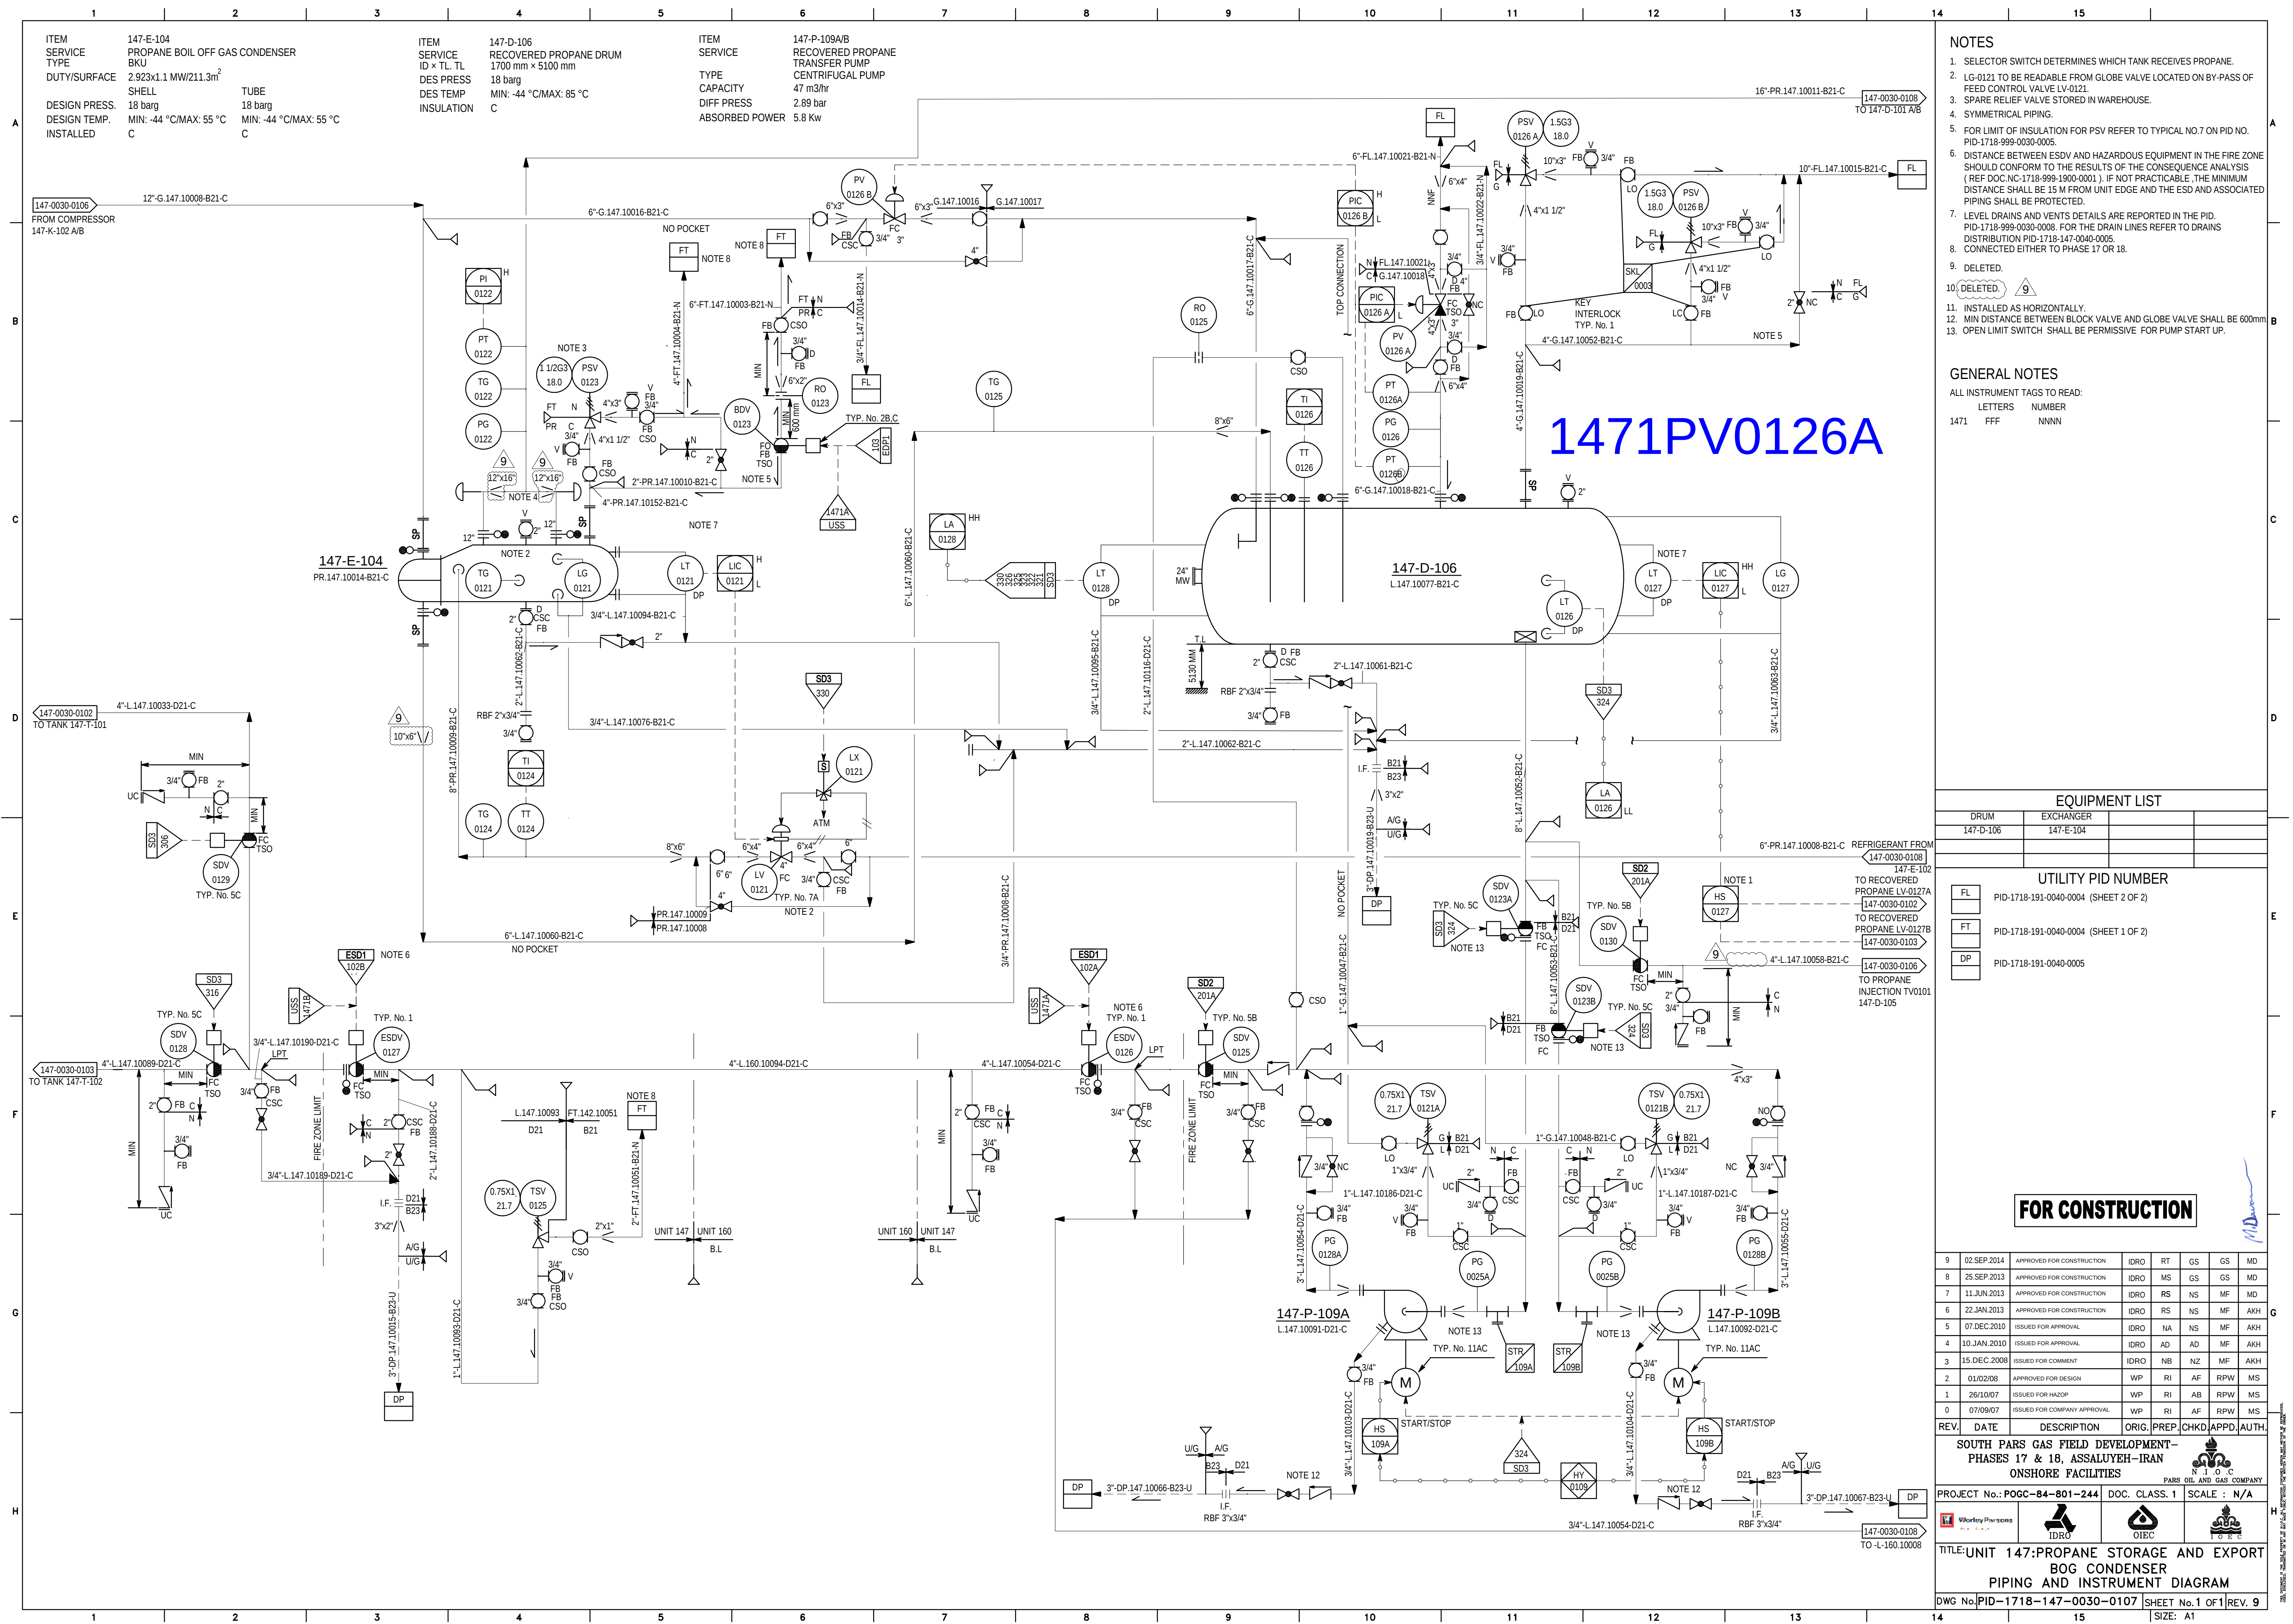

NOTES

3. SELECTOR SWITCH DETERMINES WHICH TANK RECEIVES PROPANE.
4. LG-0121 TO BE READABLE FROM GLOBE VALVE LOCATED ON BY-PASS OF FEED CONTROL VALVE LV-0121.
5. SPARE RELIEF VALVE STORED IN WAREHOUSE.
6. SYMMETRICAL PIPING.
7. FOR LIMIT OF INSULATION FOR PSV REFER TO TYPICAL NO.7 ON PID NO. PID-1718-999-0030-0005.
8. DISTANCE BETWEEN ESDV AND HAZARDOUS EQUIPMENT IN THE FIRE ZONE SHALL CONFORM TO THE RESULTS OF THE CONSEQUENCE ANALYSIS (REF DOC.NC-1718-999-1900-0001). IF NOT PRACTICABLE, THE MINIMUM DISTANCE SHALL BE 15 M FROM UNIT EDGE AND THE ESD AND ASSOCIATED PIPING SHALL BE PROTECTED.
9. LEVEL DRAINS AND VENTS DETAILS ARE REPORTED IN THE PID. PID-1718-999-0030-0008. FOR THE DRAIN LINES REFER TO DRAINS DISTRIBUTION PID-1718-147-0040-0005.
10. CONNECTED EITHER TO PHASE 17 OR I8.
11. DELETED.
12. DELETED.
13.  9
14. INSTALLED AS HORIZONTALLY.
15. MIN DISTANCE BETWEEN BLOCK VALVE AND GLOBE VALVE SHALL BE 600mm
16. OPEN LIMIT SWITCH SHALL BE PERMISSIVE FOR PUMP START UP.

GENERAL NOTES

ALL INSTRUMENT TAGS TO READ

	LETTERS	NUMBERS
1471	FFF	NNNN

EQUIPMENT LIST

DRUM	EXCHANGER		
147-D-106	147-E-104		

UTILITY PID NUMBER

FL	PID-1718-191-0040-0004 (SHEET 2 OF 2)
FT	PID-1718-191-0040-0004 (SHEET 1 OF 2)
DP	PID-1718-191-0040-0005

FOR CONSTRUCTION

02.SEP.2014	APPROVED FOR CONSTRUCTION	IDRO	RT	GS	GS	MD
25.SEP.2013	APPROVED FOR CONSTRUCTION	IDRO	MS	GS	GS	MD
11.JUN.2013	APPROVED FOR CONSTRUCTION	IDRO	RS	NS	MF	MD
22.JAN.2013	APPROVED FOR CONSTRUCTION	IDRO	RS	NS	MF	AKH
07.DEC.2010	ISSUED FOR APPROVAL	IDRO	NA	NS	MF	AKH
10.JAN.2010	ISSUED FOR APPROVAL	IDRO	AD	AD	MF	AKH
15.DEC.2008	ISSUED FOR COMMENT	IDRO	NB	NZ	MF	AKH
01/02/08	APPROVED FOR DESIGN	WP	RI	AF	RPW	MS
26/10/07	ISSUED FOR HAZOP	WP	RI	AB	RPW	MS
07/09/07	ISSUED FOR COMPANY APPROVAL	WP	RI	AF	RPW	MS

**SOUTH PARS GAS FIELD DEVELOPMENT
PHASES 17 & 18, ASSALUYEH-IRAN
ONSHORE FACILITIES**

PROJECT No.: POGC-84-801-244	DOC. CLASS. 1	SCALE : N/A
------------------------------	---------------	-------------

			
---	---	---	---

LE:UNIT 147:PROPANE STORAGE AND EXPORT
BOG CONDENSER
PIPING AND INSTRUMENT DIAGRAM

G No.	PID-1718-147-0030-0107	SHEET No.1 OF1	REV. 9
-------	------------------------	----------------	--------