


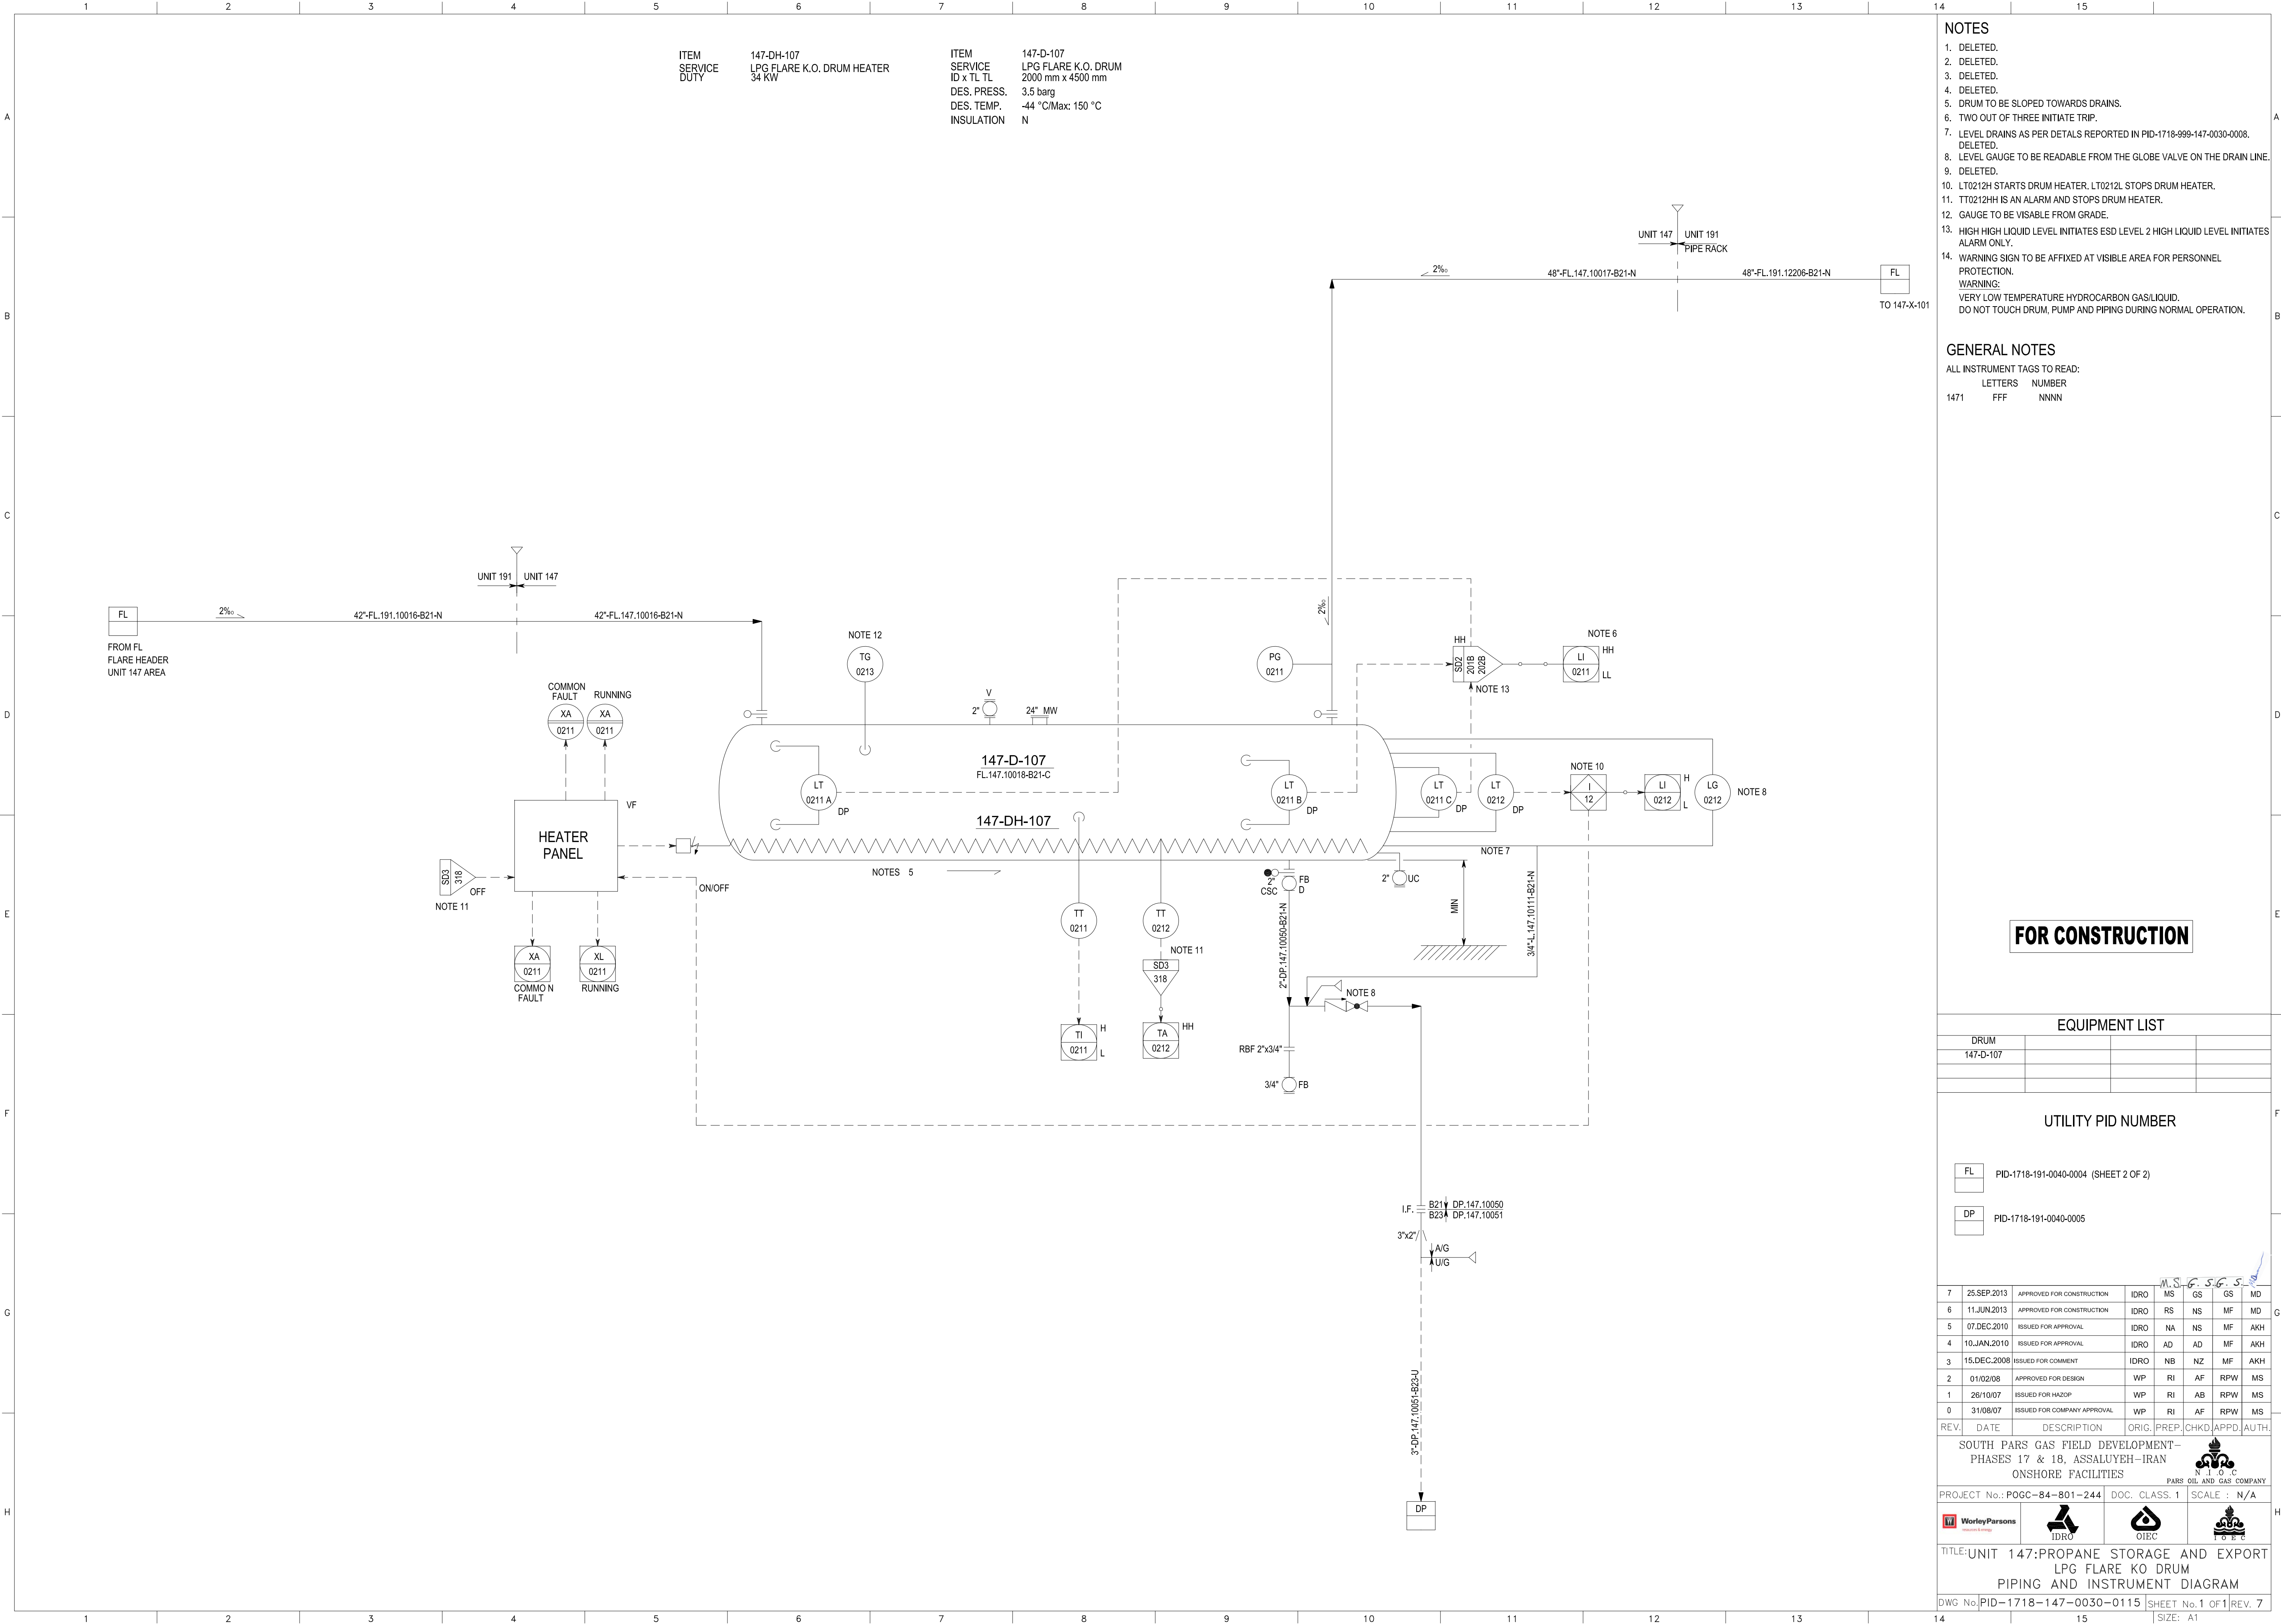

NOTES

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.
5. DRUM TO BE SLOPED TOWARDS DRAINS.
6. TWO OUT OF THREE INITIATE TRIP.
7. LEVEL DRAINS AS PER DETAILS REPORTED IN PID-1718-999-147-0030-0008. DELETED.
8. LEVEL GAUGE TO BE READABLE FROM THE GLOBE VALVE ON THE DRAIN LINE. DELETED.
9. DELETED.
10. LT0212H STARTS DRUM HEATER, LT0212L STOPS DRUM HEATER.
11. TT0212HH IS AN ALARM AND STOPS DRUM HEATER.
12. GAUGE TO BE VISABLE FROM GRADE.
13. HIGH HIGH LIQUID LEVEL INITIATES ESD LEVEL 2 HIGH LIQUID LEVEL INITIATES ALARM ONLY.
14. WARNING SIGN TO BE AFFIXED AT VISIBLE AREA FOR PERSONNEL PROTECTION.
WARNING:
VERY LOW TEMPERATURE HYDROCARBON GAS/LIQUID.
DO NOT TOUCH DRUM, PUMP AND PIPING DURING NORMAL OPERATION.

GENERAL NOTES

ALL INSTRUMENT TAGS TO READ:

LETTERS	NUMBER
1471	FFF NNNN

FOR CONSTRUCTION

EQUIPMENT LIST

DRUM			
147-D-107			

UTILITY PID NUMBER

FL	PID-1718-191-0040-0004 (SHEET 2 OF 2)
DP	PID-1718-191-0040-0005

7	25.SEP.2013	APPROVED FOR CONSTRUCTION	IDRO	MS	GS	GS	MD
6	11.JUN.2013	APPROVED FOR CONSTRUCTION	IDRO	RS	NS	MF	MD
5	07.DEC.2010	ISSUED FOR APPROVAL	IDRO	NA	NS	MF	AKH
4	10.JAN.2010	ISSUED FOR APPROVAL	IDRO	AD	AD	MF	AKH
3	15.DEC.2008	ISSUED FOR COMMENT	IDRO	NB	NZ	MF	AKH
2	01/02/08	APPROVED FOR DESIGN	WP	RI	AF	RPW	MS
1	26/10/07	ISSUED FOR HAZOP	WP	RI	AB	RPW	MS
0	31/08/07	ISSUED FOR COMPANY APPROVAL	WP	RI	AF	RPW	MS
REV.	DATE	DESCRIPTION	ORIG.	PREP.	CHKD.	APPD.	AUTH.

SOUTH PARS GAS FIELD DEVELOPMENT-
PHASES 17 & 18, ASSALUYEH-IRAN
ONSHORE FACILITIES

PARS OIL AND GAS COMPANY

PROJECT No.: POGC-84-801-244	DOC. CLASS. 1	SCALE : N/A
WorleyParsons	IDRO	OIEC

TITLE:UNIT 147:PROPANE STORAGE AND EXPORT
LPG FLARE KO DRUM
PIPING AND INSTRUMENT DIAGRAM

DWG No.	PID-1718-147-0030-0115	SHEET No. 1 OF 1	REV. 7
SIZE:	A1		